

Load Forecasting Using Time Series Models

¹Fadhilah Abd. Razak, ²Mahendran Shitan, ³Amir H. Hashim dan ³Izham Z. Abidin

¹Department of Science and Mathematics,
³Department of Electrical Engineering,
College of Engineering,
Universiti Tenaga Nasional
Malaysia

²Laboratory of Statistics and Applied Mathematics,
Institute for Mathematical Research (INSPEM),
Universiti Putra Malaysia
Malaysia
E-mail: fadhilah@uniten.edu.my

Received Date: 17th July 2007 Accepted Date: 1st August 2008

ABSTRACT

Load forecasting is a process of predicting the future load demands. It is important for power system planners and demand controllers in ensuring that there would be enough generation to cope with the increasing demand. Accurate model for load forecasting can lead to a better budget planning, maintenance scheduling and fuel management. This paper presents an attempt to forecast the maximum demand of electricity by finding an appropriate time series model. The methods considered in this study include the Naïve method, Exponential smoothing, Seasonal Holt-Winters, ARMA, ARAR algorithm, and Regression with ARMA Errors. The performance of these different methods was evaluated by using the forecasting accuracy criteria namely, the Mean Absolute Error (MAE), Root Mean Square Error (RMSE) and Mean Absolute Relative Percentage Error (MARPE). Based on these three criteria the pure autoregressive model with an order 2, or AR (2) under ARMA family emerged as the best model for forecasting electricity demand.

Keywords: Load forecasting, ARMA model, parameter estimation, AICC statistic, validation tests.

ABSTRAK

Peramalan tenaga elektrik adalah proses ramalan permintaan tenaga elektrik untuk masa hadapan. Ianya penting bagi para perancang sistem kuasa dan pihak pemantau permintaan memastikan penghasilan tenaga elektrik yang mencukupi untuk menampung pertambahan permintaan. Model yang tepat untuk ramalan tenaga elektrik boleh menentukan perancangan bajet yang lebih baik, penyelenggaraan berjadual dan pengurusan bahan bakar. Kertas kerja ini membentangkan satu usaha untuk meramalkan

permintaan elektrik maksimum dengan mencari satu model siri masa yang sesuai. Kaedah-kaedah yang dipertimbangkan dalam kajian ini termasuklah kaedah Naïve, 'Exponential smoothing', 'Seasonal Holt-Winters', ARMA, algoritma ARAR, dan Regresi bersama ralat ARMA. Prestasi kaedah-kaedah yang berbeza ini dinilai dengan menggunakan kriteria ketepatan peramalan terutamanya Ralat bagi Min Mutlak (MAE), Ralat bagi Punca Kuasa Dua Min (RMSE) dan Ralat bagi Peratus Min Relatif Mutlak (MARPE). Berdasarkan kepada tiga kriteria tersebut model autoregresif peringkat ke-2, atau AR (2) dalam keluarga ARMA muncul sebagai model yang terbaik bagi ramalan permintaan elektrik.

Kata kunci: Peramalan tenaga elektrik, model ARMA, penganggaran parameter, statistik AICC, ujian pengesahan.

INTRODUCTION

Malaysia's National electricity utility company (TNB) is the largest in the industry, serving over six million customers throughout Malaysia. TNB's core activities are in the generation, transmission and distribution of electricity. The Transmission Division is responsible for the whole spectrum of transmission activities ranging from system planning, evaluating, implementing and maintaining the transmission assets. One of the requirements of the system planning is load forecasting.

Load forecasting is a process of predicting the future load demands. It is important for electricity power system planners and demand controllers in ensuring that there would be enough supply of electricity to cope with an increasing demand. Load forecasting can also determine which generators need to be dispatched, or kept as a backup or on spinning reserve status (Izham Zainal Abidin 2005). Thus, accurate load forecasting can lead to an overall reduction of cost, better budget planning, maintenance scheduling and fuel management.

Load forecasts can be divided into three categories: short-term (STLF), medium-term (MTLF), and long-term forecasts (LTLF). STLF, which is usually from one hour to one week, is concerned with forecast of hourly and daily peak system load, and daily or weekly system energy. It is needed for control and scheduling of power system, and also as inputs to load flow study or contingency analysis. Some of the techniques used for STLF are multiple linear regression, stochastic time series and artificial intelligence based approach. MTLF relates to a time frame from a week to a year and LTLF relates to more than a year. MTLF and LTLF are required for maintenance scheduling, fuel and hydro planning, and generation and transmission expansion planning. The common

techniques used for MTLF and LTLF are time trend extrapolation and econometric multiple regression (Feinberg & Genethlion 2005; Lee & Park 1992; Weerakorn Ongsakul 2006).

However, time series modeling is one of the popular methods used by many researchers for load forecasting. Cho et al. (1995) proposed ARIMA model and transfer function model for customer load forecasting during one week by considering weather-load relationship. Results showed that ARIMA Transfer Function Models could achieve better accuracy of load forecast than the traditional ARIMA model. Nirma Amjady (2001) proposed a modified ARIMA, which combined the operators' estimation as the initial forecasting with the temperature and load data in a multi-variable regression process. The forecasting accuracy of the modified ARIMA was found to be better than ARIMA. Carter & Zellner (2003) found out that the non-linear least squares estimation of the ARAR estimation of the parameters required less iteration than ARMA estimates. Gould et al. (2005) discussed the weakness of Holt-Winters (HW) exponential smoothing approach in forecasting the hourly electricity demand. They claimed that HW failed to pick up the similarities from day-to-day at a particular time and proposed a new approach for forecasting time series with Multiple Seasonal Pattern (MS). The MS model, which employed single source of error models, provided more accurate forecasts than the HW models because of its flexibilities. The MS model allowed for each day to have its own hourly pattern or to have some days with the same pattern.

In this paper, an attempt was made to forecast the maximum demand of electricity by finding an appropriate time series model. The time series models considered in this study include Naïve, Seasonal Holt-Winters, ARMA, ARAR

algorithm and Regression with ARMA Errors. The performance of these different models was evaluated using the forecasting accuracy criteria namely, the Mean Absolute Error (MAE), Root Mean Square Error (RMSE) and Mean Absolute Relative Percentage Error (MARPE).

Time series modeling

A time series is a set of observations x_t , each one being recorded at a specific time t and denoted by $\{X_t\}$. It can be represented as a realization of the process based on the general model called Classical Decomposition Model, and specified as follows:

$$X_t = m_t + s_t + Y_t \quad (1)$$

$t = 1, 2, \dots, n$, where m_t is a trend component, s_t is a seasonal component and Y_t is a random noise component which is stationary (Brockwell & Davis 2002).

The goal for a time series modeling is to predict data series that are typically not deterministic but contain a random component. The deterministic components, m_t and s_t need to be estimated and eliminated as to make the residue or noise component Y_t to be stationary time series. The time series $\{X_t\}$ is said to be stationary if the mean and the auto-covariance function of $\{X_t\}$ are independent of time. A non-stationary time series needs to be transformed to a stationary time series. Then only a satisfactory probabilistic model can be determined for the process Y_t to analyze its properties and to use it for prediction purposes.

ARIMA processes

ARIMA (auto-regressive integrated moving average) processes are a major part of time series modeling and used for a wide range of non-stationary series. Each ARIMA process has three parts; the autoregressive part (or AR), the integrated (or I) part, and the moving average (or MA) part. The models are denoted by ARIMA (p, d, q). ARMA (auto-regressive moving average) models denoted by ARMA (p, q) come from an important parametric family of linear time series models, which provide a general framework for studying stationary processes. Method of differencing is introduced to transform the non-stationary ARIMA into stationary series ARMA and parameter d stands for the degree of first

differencing involved. In other words, when $d = 0$, the model represents a stationary process (Box et al., 1994 & Makridakis et al., 1998).

A stationary ARMA (p, q) model is defined as a sequence of random variables $\{Z_t\}$, given by

$$\begin{aligned} X_t - \phi_1 X_{t-1} - \dots - \phi_p X_{t-p} \\ = Z_t + \theta_1 Z_{t-1} + \dots + \theta_q Z_{t-q} \end{aligned} \quad (2)$$

where $\{Z_t\}$ is a sequence of uncorrelated random variables with zero mean and constant variance denoted as $\{Z_t\} \sim WN(0, \sigma^2)$ and the polynomials $(1 - \phi_1 z - \dots - \phi_p z^p)$ and $(1 + \theta_1 z + \dots + \theta_q z^q)$ have no common factors.

The process $\{X_t\}$ is said to be an ARMA (p, q) process with mean μ if $\{X_t - \mu\}$ is an ARMA (p, q) process and conveniently written in the more concise form of

$$\phi(B)X_t = \theta(B)Z_t, \quad (3)$$

where

$\phi(\cdot)$ and $\theta(\cdot)$ are the p^{th} and q^{th} degree polynomials,

$$\phi(z) = 1 - \phi_1 z - \dots - \phi_p z^p,$$

$$\theta(z) = 1 + \theta_1 z + \dots + \theta_q z^q,$$

B is the backward shift operator ($B^j X_t = X_{t-j}$, $B^j Z_t = Z_{t-j}$, $j=0, \pm 1, \dots$).

The time series $\{X_t\}$ is said to be an auto-regressive process of order p (or AR (p)) if $\phi(z) = 1$ and a moving average process of order q (or MA (q)) if $\theta(z) = 1$ (Brockwell & Davis 2002).

METHODOLOGY

This section describes the procedures of establishing an appropriate time series model for load forecasting. The procedures include data plotting, data transformation, model selection, parameter estimation, validation tests, and forecasting. Analysis is done using Interactive Time Series Modeling (ITSM). ITSM is a totally windows-based computer package for univariate and multivariate time series modeling and forecasting.

The data set

The load data used in this research was a Power Load Profile for a utility company. The data represented the monthly mean maximum demand measured in Megawatts (MW) in 52

months from September 2000 to December 2004. The time series plot of the monthly mean maximum demand is given in Figure 1. It appears from the graph that the maximum demand has an upward linear trend. The variance of the series is stable and thus no logarithmic or any other transformation is needed. There is a seasonal pattern with a few troughs occurring between November to February each year. This may be due to various holidays such as school holidays, Hari Raya and Chinese New Year. These patterns reveal that the series is not stationary and hence need to be transformed before attempting to fit a stationary model.

ARMA model

Transformations are applied to produce data that can be successfully modeled as stationary

time series. The series clearly shows a seasonality of period 12 as it is derived from a monthly data with an annual seasonal pattern. The data was differenced at lag 12 and 1 to obtain an approximate stationary series. Figure 2 shows the differenced series derived from the monthly mean maximum demand has no apparent deviations from stationarity.

These differenced series were 'mean-corrected' by subtraction of the sample mean, so that it is appropriate to fit a zero-mean ARMA model to the adjusted data. The selection of the appropriate parameters of ARMA (p, q) model depends on a variety of tools, which include the sample ACF (autocorrelation function), the sample PACF (partial autocorrelation function) and the AICC statistic (Brockwell & Davis 2002).

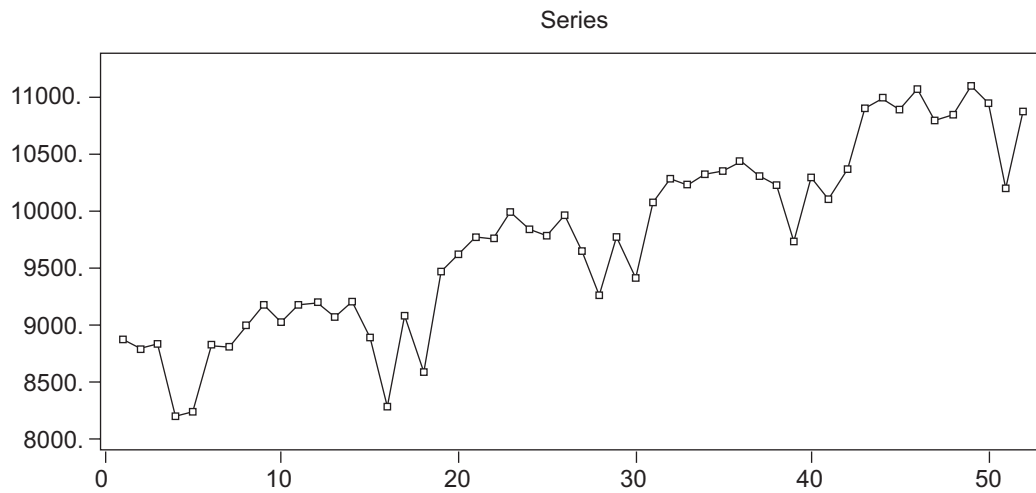


Figure 1. The Maximum Demand from September 2000 to December 2004

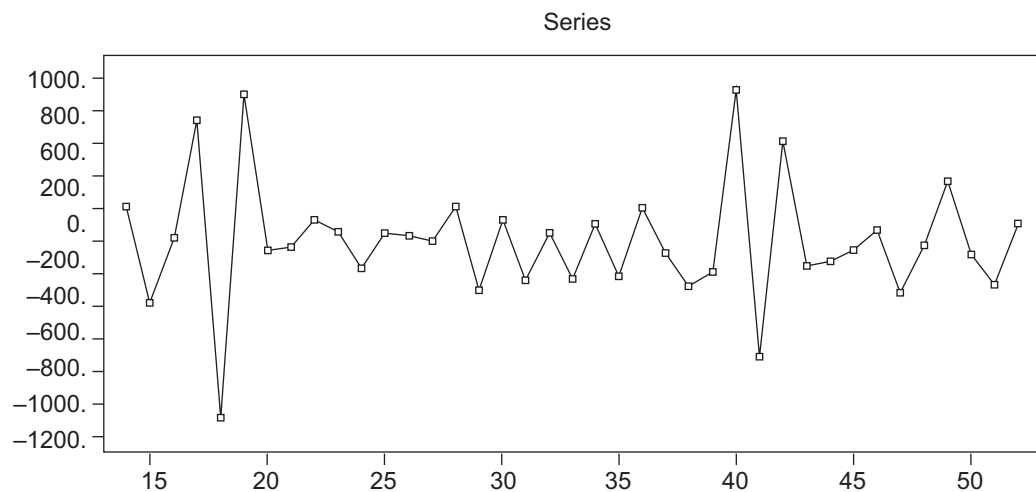


Figure 2. The Time Series of the Residuals after Differencing at lag 1 and 12

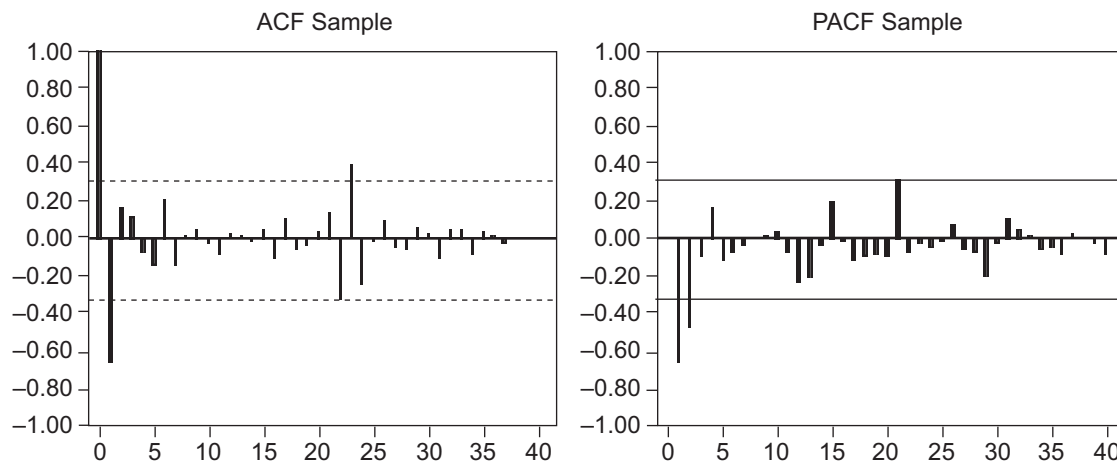


Figure 3. The Sample ACF and PACF of the Differenced Series

The graphs of the sample ACF and PACF shown in Figure 3 suggest an appropriate ARMA model for the data. The ACF will represent a pure MA (q) model and the PACF will represent a pure AR (p) model. Since the ACF vanishes for lags greater than 1 and the PACF vanishes for lags greater than 2, MA (1) and AR (2) are possible models. However, other models such as AR (1) and a combined model of ARMA (2, 1) might also be considered as the potential models.

Even if the sample ACF or PACF does suggest an appropriate ARMA model for the data, it is still advisable to explore other models. The AICC criterion provides a rational criterion for choosing between competing models and it is an asymptotically biased estimate of the fitted model relative to the true model. AICC statistic is given by

$$AICC = -2 \ln \text{Likelihood}(\hat{\phi}, \hat{\theta}, \hat{\sigma}^2) + \left[\frac{2n(p+q+1)}{n-(p+q)-2} \right] \quad (4)$$

where $\hat{\phi}$ = a class of AR parameters,
 $\hat{\theta}$ = a class of MA parameters,
 $\hat{\sigma}^2$ = estimated variance of white noise,
 n = number of observations,
 p = order of AR component,
 q = order of MA component.

'Likelihood ($\hat{\phi}, \hat{\theta}, \hat{\sigma}^2$)' is a measure of the plausibility of the observed series given the parameter values of $\hat{\phi}, \hat{\theta}, \hat{\sigma}^2$ (Brockwell & Davis 2002; Makridakis et al.1998). Smallness of the AICC value is indicative of a good model and this can be achieved using the maximum likelihood estimation, which estimates the parameters

iteratively.

Once a model is obtained, it is important to check for the appropriateness of the model. If the data were truly generated by the fitted ARMA (p, q) model with white noise sequence $\{Z_t\}$, then for large samples the properties of the residuals should reflect those of $\{Z_t\}$. Various validation tests are performed on the suggested models. These tests are the McLeod-Li Portmanteau Test, the Turning Point Test, the Difference Sign Test and the Rank Test. The residuals of the suggested models have to pass all the tests before it can be considered as the best model for forecasting (Brockwell & Davis 2002).

If there are instances where many models pass the validation tests, the most adequate model can still be assessed by looking into the forecasting accuracy criteria. The criteria chosen to measure the accuracy of the forecast in this study are Mean Absolute Error (MAE), Root Mean Square Error (RMSE) and Mean Absolute Relative Percentage Error (MARPE) which are given respectively by the following equations,

$$MAE = \frac{\sum_{i=1}^n |x_i - \hat{x}_i|}{n}, RMSE = \sqrt{\frac{\sum_{i=1}^n (x_i - \hat{x}_i)^2}{n}} \text{ and} \\ MARPE = \frac{\sum_{i=1}^n \left| \frac{x_i - \hat{x}_i}{x_i} \right|}{n} \times 100\% \quad (5)$$

where x_i and \hat{x}_i are the actual observed values and the predicted values, respectively while n is the number of predicted values.

Comparison with other forecasting techniques

Comparisons are made between the ARMA models with the other time series models such as Naïve, Holt-Winter's Trend and Seasonal, ARAR

forecast and Regression with ARMA errors. These methods are briefly described as follows:

Naïve

Naïve forecasting neglects all past data except for the time period that occurred last. It may be adequate for dealing with many of the minimal consequence decisions of daily life and more effective at short-term applications. The next forecasted period F_{t+1} , is based on the most recent observation Y_t , the relation between them is given by the following equation:

$$F_{t+1} = Y_t \tag{6}$$

If recent observations are given more weight in forecasting than the older observations, the method will be called as Simple Exponential Smoothing. However this method works best for data, which have no trend, no seasonality, or other underlying pattern (Makridakis et al. 1998)

Holt-Winter’s Trend and Seasonality Method (HW)

The HW method is an extension of Holt’s Linear Method that considers series with trend and seasonality. The method is based on three smoothing equations – one for the level, one for trend, and one for seasonality, which can be either additive or multiplicative seasonality. Multiplicative seasonality is considered in this paper since it is more commonly used. The basic equations are:

$$\text{Level: } L_t = \alpha \frac{Y_t}{S_{t-s}} + (1-\alpha)(L_{t-1} + m_{t-1}) \tag{7}$$

$$\text{Trend: } m_t = \beta (L_t - L_{t-1}) + (1-\beta)m_{t-1} \tag{8}$$

$$\text{Seasonal: } S_t = \gamma \frac{Y_t}{L_t} + (1-\gamma)S_{t-s} \tag{9}$$

$$\text{Forecast: } F_{t-q} = (L_t + m_t q)S_{t-s+q} \tag{10}$$

where s is the length of seasonality, L_t is the level of the series, m_t is the trend, S_t is the seasonal component, and F_{t+q} is the forecast for q periods ahead (Makridakis et al. 1998).

ARAR forecast

ARAR model is suitable for forecasting the series $\{Y_t\}$ whereby a memory-shortening transformation sequence has been applied. The

memory-shortened series is

$$S_t = Y_t + \psi_1 Y_{t-1} + \dots + \psi_k Y_{t-k} \tag{11}$$

where $\psi_1, \psi_2, \dots, \psi_k$ are the coefficients of the chosen filter and $t = 1, \dots, T$. Let \bar{S} denotes the sample mean of S_1, \dots, S_T . Thus, the fitted model is given by

$$X_t = \phi_1 X_{t-1} + \phi_2 X_{t-2} + \phi_3 X_{t-3} + Z_t \tag{12}$$

where $X_t = S_t - \bar{S}$, $\{Z_t\} \sim \text{WN}(0, \sigma^2)$, and for given lags l_1, l_2, \dots, l_k and t , the coefficients ϕ_j and σ^2 are from Yule-Walker estimation (Brockwell & Davis 2002).

Regression model with ARMA errors

Regression model with ARMA errors is a combination of a multiple regression model with an ARMA model. The general model takes the form

$$Y = X\beta + W \tag{13}$$

using matrix notation, where $Y = (Y_1, Y_2, \dots, Y_n)$ is the response vector observed at time $t = 1, 2, \dots, n$, X is the design matrix consisting of the n explanatory variables with columns being $1, t, t^2, \dots, t^k$ and $\beta = (\beta_1, \beta_2, \dots, \beta_n)'$ is the vector of regression coefficients and $W = (W_1, W_2, \dots, W_n)'$ are observations from a causal zero mean ARMA (p, q) process (Brockwell & Davis 2002). First ordinary least estimates are computed for β and then the estimated residuals ARMA (p, q) model is fitted by the maximum likelihood method.

Finally, for the fitted ARMA (p, q) model, generalized least squares are computed for the regression coefficients and the process is repeated until the estimates have stabilized.

RESULTS & DISCUSSION

ARMA Model

The estimated ARMA models for forecasting the maximum demand of electricity with their corresponding AICC values are given in Table 1. Clearly AR (2) has the minimum AICC value and can be considered as the most appropriate model if compared among the other models under ARMA. The equation for the model is given by

$$X_t = -0.9381X_{t-1} - 0.4508X_{t-2} + Z_t \tag{14}$$

where $Z_t \sim \text{WN}(0, 61556.9)$.

Table 1. Estimated Models Based on the Maximum Likelihood

Model	Equation	AICC
AR(1)	$X_t = -0.6427 X_{t-1} + Z_t$	555.08
AR(2)	$X_t = -0.9381 X_{t-1} - 0.4508 X_{t-2} + Z_t$	548.44
MA(1)	$X_t = Z_t - 0.7520 Z_{t-1}$	552.25
ARMA(2,1)	$X_t = -0.8565 X_{t-1} - 0.4005 X_{t-2} + Z_t - 0.1066 Z_{t-1}$	550.78

Table 2. Validation Tests on AR (2) Model

Ljung - Box statistic = 13.020 Chi-Square (20), p-value = 0.87652

McLeod - Li statistic = 18.835 Chi-Square (22), p-value = 0.65549

Turning points = 24.000~AN(24.667,sd = 2.5712), p-value = 0.79542

Diff sign points = 17.000~AN(19.000,sd = 1.8257), p-value = 0.27332

Rank test statistic = 0.32100E+03~AN(0.37050E+03,sd = 41.333), p-value = 0.23108

Jarque-Bera test statistic (for normality) = 2.0607 Chi-Square (2), p-value = 0.35688

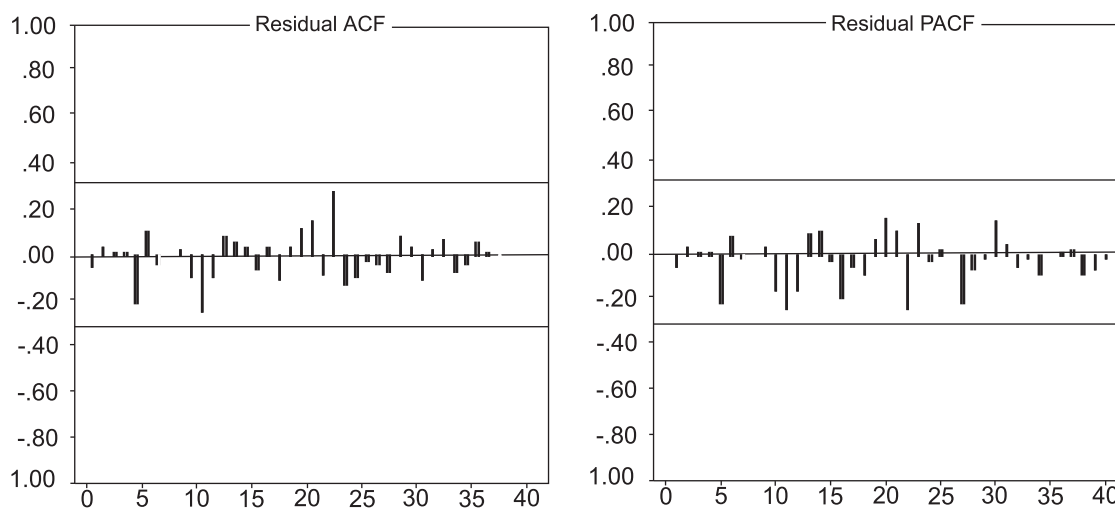


Figure 4. The ACF and PACF of sample residuals

Validation tests were performed on the AR (2) model that had the minimum AICC value and the result of the tests are shown in Table 2. AR (2) model passes all the tests with p-values greater than 5% indicating that there is insufficient evidence to reject the null hypothesis that the residuals are white noise.

The graphs of the ACF and PACF (see Figure 4) of the residuals also has no more spikes beyond the 95% confidence limits indicating further that AR (2) is indeed an appropriate model.

Based on Equation (14), the forecasted values from January 2005 (Month 53) to May 2005 (Month 57) and the 95% prediction bounds are computed and presented in Table 3.

Table 3. Forecasting maximum demand in MW for 5 months

AR(2)		95% Prediction Bounds		
Month	Actual	Forecast	Lower	Upper
Jan	10817	10720	10234	11206
Feb	10976	10927	10439	11414
March	11591	11514	10971	12056
April	11483	11598	11001	12195
May	11410	11495	10880	12109

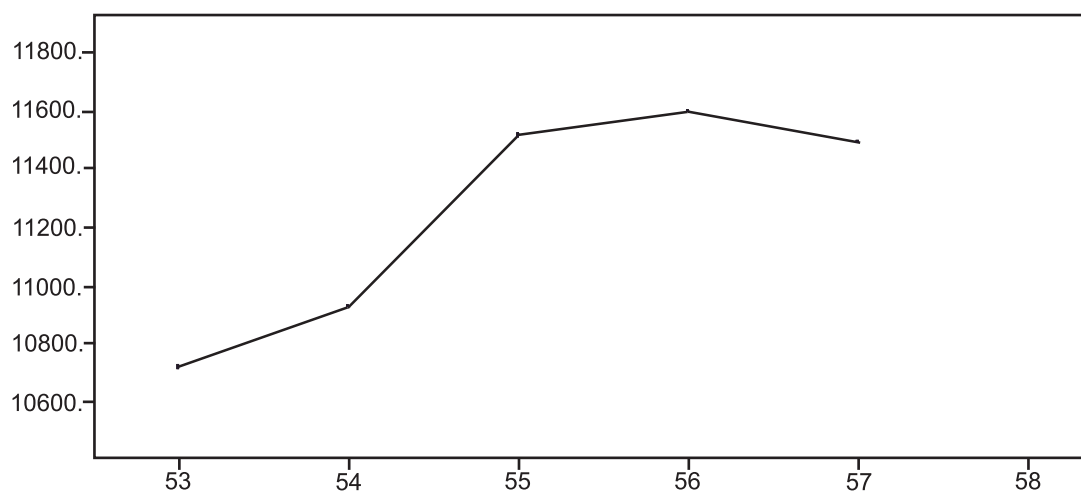


Figure 5. Forecast of 5 months based on AR (2)

The percentage difference of each forecast value compared to the actual value is less than 1%. Figure 5 shows a plot of the forecasts for 5 months as given by Table 3.

Regression model with ARMA errors

The regression results with ARMA errors are as follows. A linear regression fit, is given by

$$Y_t = 8462.51 + 48.50t + W_t \quad (15)$$

where, Y_t represents the maximum demand of electricity and W_t are the residuals. The autocorrelation function (ACF) and partial autocorrelation function (PACF) of the residuals obtained after the regression fit are shown in Figure 6 from which it is clear that the residuals are correlated to a large extent.

Hence to the residuals $\{W_t\}$, a stationary ARMA process was fitted based on the AICC criterion and the parameters were estimated by the maximum likelihood method. The fitted ARMA process was ARMA (4, 1) given by the following equation,

$$W_t = 0.8733 W_{t-1} + 0.01334 W_{t-2} - 0.1234 W_{t-3} - 0.2889 W_{t-4} + Z_t - 0.7961 Z_{t-1} \quad (16)$$

where $\{Z_t\}$, $\sim WN(0, 60451.1)$.

The values of AICC and AICC (corrected for regression) were 735.9 and 741.4 respectively. With these ARMA (4, 1) errors in Equation (16), a generalized least squares fit was obtained and it is given by

$$Y_t = 8432.5476 + 49.581074t + W_t \quad (17)$$

Based on the model given by Equation (17), a plot of the data and five forecasted values from January 2005 (Month 53) to May 2005 (Month 57) are shown in Figure 7.

Both models of AR (2) and Regression with ARMA errors are compared with other time series models. Post Sample Accuracy Criteria of each time series model are summarized in Table 4. From Table 4, AR (2) records the lowest MARPE and thus is a better model for forecasting the maximum demand of electricity in a utility company.

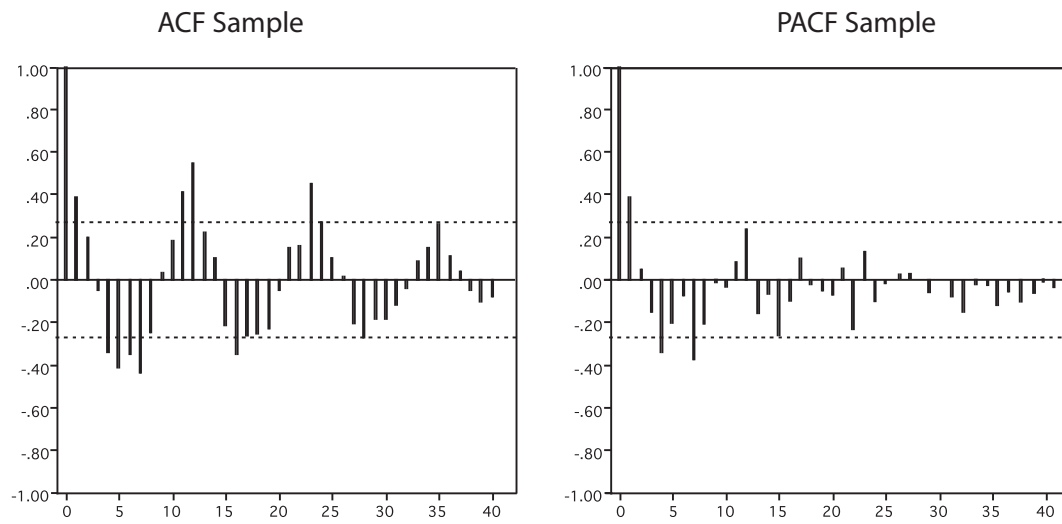


Figure 6. ACF and PACF of sample residuals

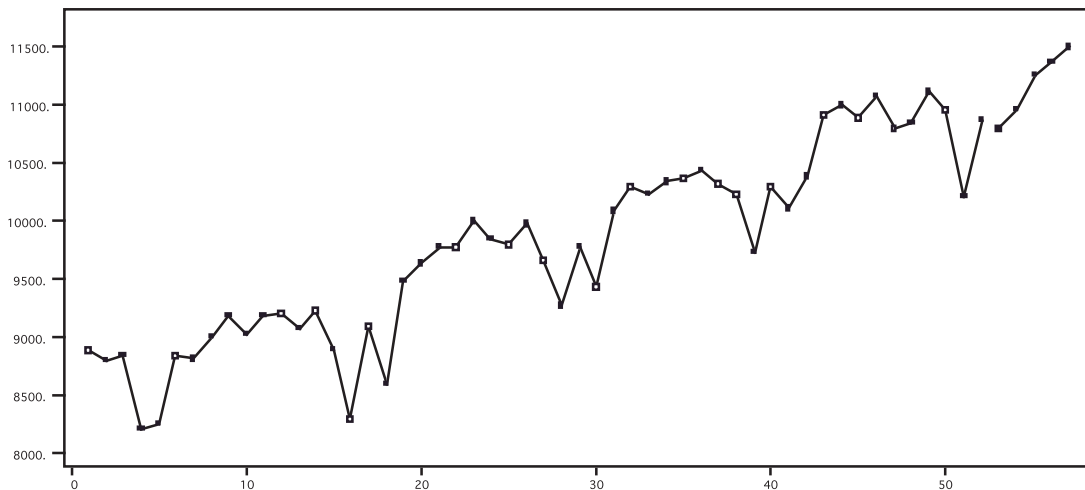


Figure 7. Plot of 5 forecasted values based on Regression Model

Table 4. Post Sample Accuracy Criteria

Time Series Model	MAE	RMSE	MARPE
AR (2)	83.5	92.12	0.736
Naïve	108.63	124.5	0.954
ARMA (2,1)	83.75	94.7	0.737
Holt-Winter's Trend and Seasonal	148.63	162	1.309
ARAR Forecast	96	110.4	0.844
Regression of Order 1	101.1	146.11	0.88

CONCLUSION

This paper presents an attempt to forecast the maximum demand of electricity by finding an appropriate time series model. Various classes of time series models, namely ARIMA, Naïve, Seasonal Holt-Winters, ARAR forecast and Regression with ARMA errors have been considered. Results indicated that AR (2), which was the mean corrected series differenced at lag 12 and 1, emerged as the best model for forecasting the maximum demand of electricity. It is suggested that models incorporating other variables like an hourly or a daily maximum demand or any intervening events may be useful

in forecasting the electricity and this will be looked into for future research.

ACKNOWLEDGMENTS

We are very grateful to the reviewers for their useful suggestions and recommendations to improve the quality of this paper. The first author would like to offer her sincere appreciation to the University of Tenaga Nasional Berhad and the second author wishes to express his thanks to the Department of Mathematics, Universiti Putra Malaysia.

REFERENCES

- Box, G.E.P., Jenkins, G. M. & Reinsel, G. C. 1994. *Forecasting and Control. Time Series Analysis. Third Edition*. New Jersey: Prentice Hall.
- Brockwell, P.J. & Davis, R.A. 2002. *Introduction to Time Series and Forecasting. Springer Texts in Statistics. Second Edition*. New York: Springer-Verlag.
- Carter, R.A.L. & Zellner, A. 2003. The ARAR Error Model for Univariate Time Series and Distributed Lag Models: *Studies in Nonlinear Dynamics and Econometrics*, 8(1): 1-42.
- Cho, M.Y., Hwang, J.C. & Chen, C.S. 1995. Customer Short Term Load Forecasting by Using ARIMA Transfer Function Model. International Conference on Energy Management and Power Delivery: *Proceedings of EMPD*, 1: 317-22. November.
- Feinberg, E.A. & Genethlion, D. 2005. *Load Forecasting. Applied Mathematics for Restructured Electric Power Systems: Optimization, Control, and Computational Intelligence*, pp. 269-285. Springer.
- Gould, P.G., Koehler, A.B., Vahid-Araghi, F., Snyder, R.D., Ord, J.K. & Hyndman, R.J. 2005. Forecasting Time-Series with Multiple Seasonal Patterns. <http://www.robhyndman.info/papers/> [11th October 2005]
- Izham Zainal Abidin. 2005. Uniten Masters in Engineering Power systems notes. *EPPM* PP 533.
- Lee, K.Y. & Park, J.H. 1992. Short-Term Load Forecasting Using An Artificial Neural Network. *IEEE Transactions on Power Systems*, 7(1): 124-30.
- Makridakis, S., Wheelwright, S.C., & Hyndman, R.J. 1998. *Forecasting: Methods and Applications*, Third Edition. New York: John Wiley & Sons, Inc.
- Nirma Amjady. 2001. Short-Term Hourly Load Forecasting Using Time-Series Modeling with Peak Load Estimation Capabiliy, *IEEE Transactions on Power Systems*, 16(3): 498-505.
- Weerakorn Ongsakul. 2006. Electricity Demand Forecasting, Energy Field of Study, *Workshop for Power Systems and Planning*, Asian Institute of Technology (AIT), Thailand, 28-30 June.